
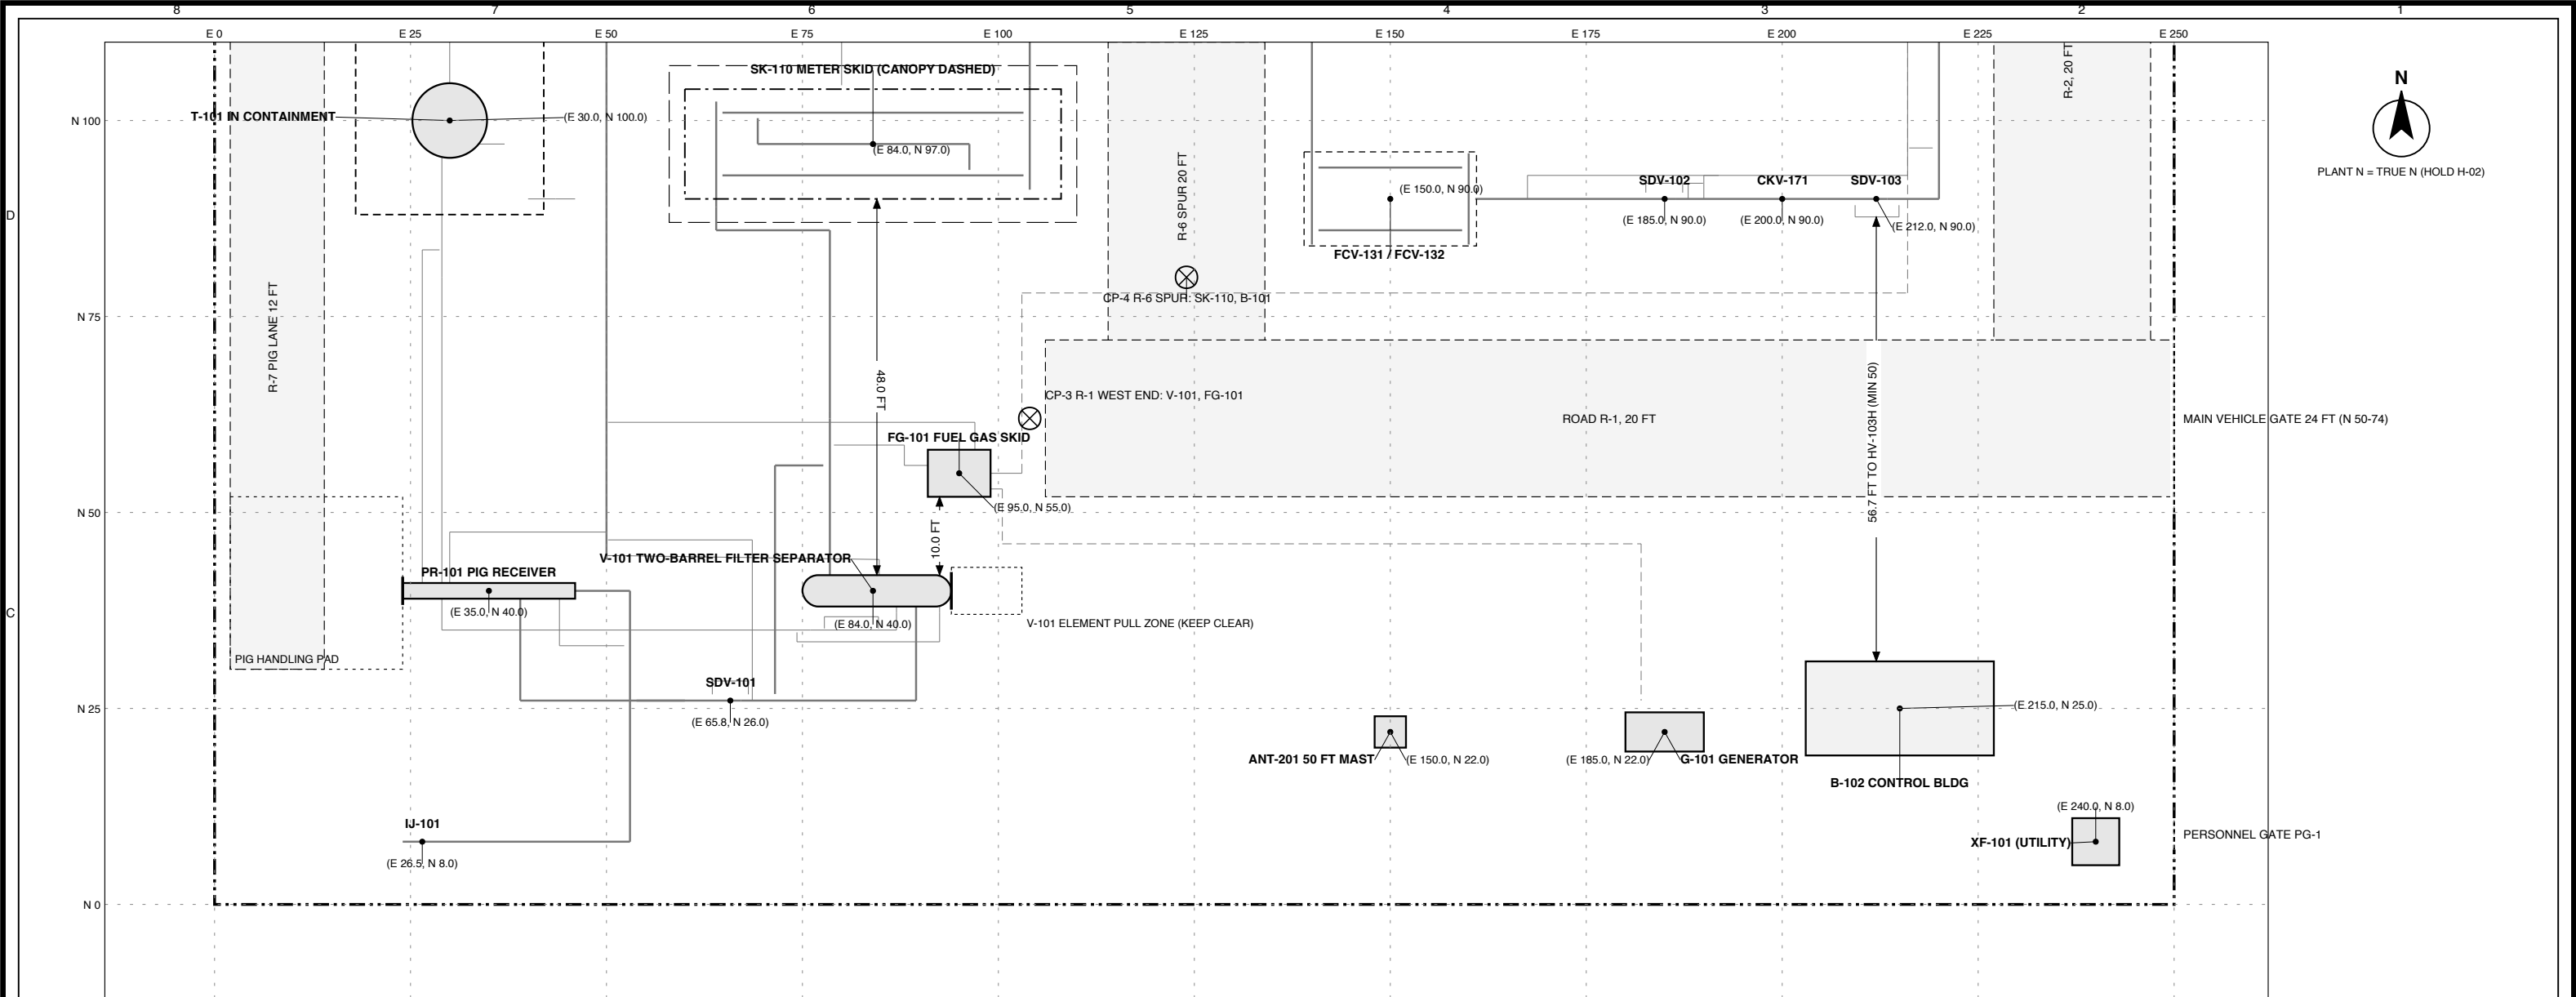


1. SOUTH HALF OF FENCED STATION (N -12 TO N 110). NORTH HALF ON SHEET 3. SPACING SUMMARY ON SHEET 1.
2. B-102 IS OUTSIDE ALL CLASSIFIED AREAS; NEAREST ABOVE-GRADE FLANGED JOINT DIMENSIONED. G-101 FUEL TRAIN (VENDOR) IS A MINOR RELEASE SOURCE ~15 FT FROM B-102: AREA CLASSIFICATION (VOL 6) TO CONFIRM.
3. PR-101 CLOSURE FACES WEST ONTO PIG PAD (DOTTED) SERVED BY R-7 PIG LANE; NO PERSONNEL WORK AREA IN LINE WITH THE CLOSURE. V-101 FILTER ELEMENTS PULLED EAST FROM THE QUICK-OPENING CLOSURE TOWARDS R-1.
4. ROAD R-1 ENDS AT E 106 WITH A HAMMERHEAD; ONLY BURIED FUEL GAS LINES CROSS ROADS (48 IN COVER).
5. FIRE EXTINGUISHERS, SIGNAGE AND BOLLARDS AT R-1 NEXT TO SDV-102/103: SEE VOL 5 / VOL 9.
- LEGEND: DASHED GREY BAND = ROAD; HEAVY DASH-DOT = FENCE; GREY LINES = PIPING (DASHED = BURIED); CIRCLED X = CRANE POSITION

EQUIPMENT ON THIS SHEET (FOOTPRINT E-W x N-S, FT; FINISHED GRADE AT CENTRE, FT NAVD88)				
TAG	E	N	FOOTPRINT	FG EL
PR-101 PIG RECEIVER	35.0	40.0	22.0 x 2.0	1151.70
SDV-101	65.8	26.0	3.8 x 2.2	1151.32
V-101 TWO-BARREL FILTER SE	84.0	40.0	19.0 x 4.0	1151.21
FG-101 FUEL GAS SKID	95.0	55.0	8.0 x 6.0	1151.17
SK-110 METER SKID	84.0	97.0	48.0 x 14.0	1151.49
FCV-131 / FCV-132	150.0	90.0	22.0 x 12.0	1150.80
SDV-102	185.0	90.0	3.8 x 2.2	1150.45
CKV-171	200.0	90.0	3.8 x 2.2	1150.30
SDV-103	212.0	90.0	3.8 x 2.2	1150.18
IJ-101	26.5	8.0	5.0 x 2.0	1151.62
T-101 IN CONTAINMENT	30.0	100.0	24.0 x 24.0	1152.05
B-102 CONTROL BLDG	215.0	25.0	24.0 x 12.0	1149.82
G-101 GENERATOR	185.0	22.0	10.0 x 5.0	1150.11
ANT-201 50 FT MAST	150.0	22.0	4.0 x 4.0	1150.46
XF-101	240.0	8.0	6.0 x 6.0	1149.49



- NOTES / REFERENCES**
1. LOCAL GRID, ORIGIN SW FENCE CORNER, FT. DIMENSIONS EDGE TO EDGE OF FOOTPRINTS.
2. EQUIPMENT FOOTPRINTS NOMINAL, CONFIRM WITH VENDOR DATA (HOLD H-15).
3. SEE SHEET 1 FOR SPACING CHECK TABLE AND BASIS vs FINAL COORDINATES.
- REF: PIP-DWG-001 PIPING GA
- REF: GEN-DB-001 SEC 10

REVISIONS			
REV	DATE	DESCRIPTION	BY CHK APP
A	2026-09-29	ISSUED FOR REVIEW (IFR)	
PRELIMINARY - ISSUED FOR REVIEW - NOT FOR CONSTRUCTION			

ENGINEER OF RECORD SEAL

NOT SEALED
PRELIMINARY

PE NO. _____

PROJECT

120 MMSCFD RECEIPT INTO _____

COUNTY, _____

DISCIPLINE: MECHANICAL
SCALE: 1 IN = 20 FT

PLOT PLAN

FENCED STATION, SOUTH HALF

DRAWN: _____ CHECKED: _____ APPROVED: _____

DWG NO. _____

MEC-DWG-001

SHEET 2 OF 3 REV A